

Hendrikx Gebr, Lomm 15654

Overview for washer januari 2020


Biological washer with 1 slave washer

Scores last year:

Total score:

10


Januari 2020

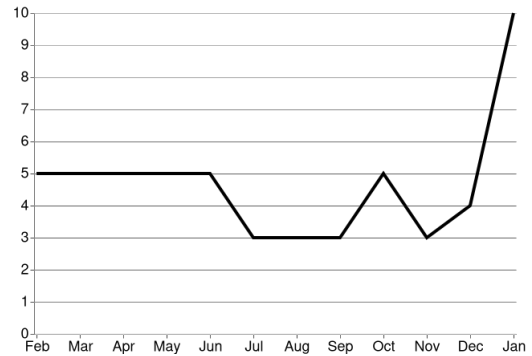


pH



Conductivity



Pump operating hours




Received measurements




Details:

Received measurements	100,0% (744 where 744 expected)
Valid pH:	99,9% of the time within margin (between 6.5 en 7.5)
Valid conductivity:	100,0% of the time within margin (<= 18)
Valid pressure drop master:	100,0% of the time within margin (<= 65)
Valid pressure drop slave 1:	100,0% of the time within margin (<= 65)
Pump operating hours:	99,7% of the time
Power usage	3,335 kWh (309.718,2 kWh total)
Water usage	120,9 m3 (18.343,5 m3 total)
Waste water	68,3 m3 (11.990,2 m3 total)


pH

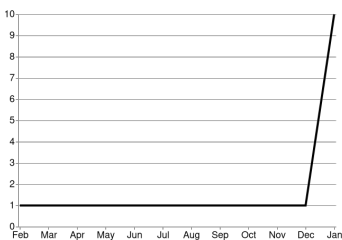

Conductivity

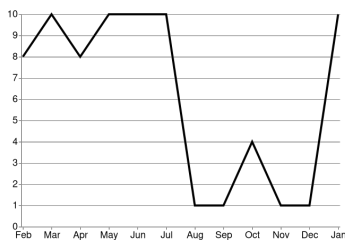

Pump operating hours

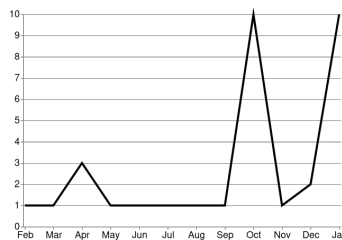

Received measurements

